

# PRODUCT DATA

COMFORT300LR BY NILAN



Horsham, West Sussex  
01403 563045



## Ventilation & passive heat recovery



Domestic



Passive  
heat recovery



Ventilation  
<400 m<sup>3</sup>/h

# COMFORT 300LR


## Product description


The Comfort 300LR is an energy-efficient ventilation unit with heat recovery for homes and smaller commercial buildings with a ventilation requirement of up to 400 m<sup>3</sup>/h.

This unit has been thoroughly tested, with improvements being continually made during its manufacture for more than 15 years. These improvements focused on low energy consumption, easy user operation and maintenance.

As a result, service access is available from both sides, which means that the Comfort 300LR can be used as a “right” or “left” model. This offers a flexible and easy installation.

The Comfort 300LR is factory tested and ready for use. Installation and commissioning must be performed by an authorised electrician.

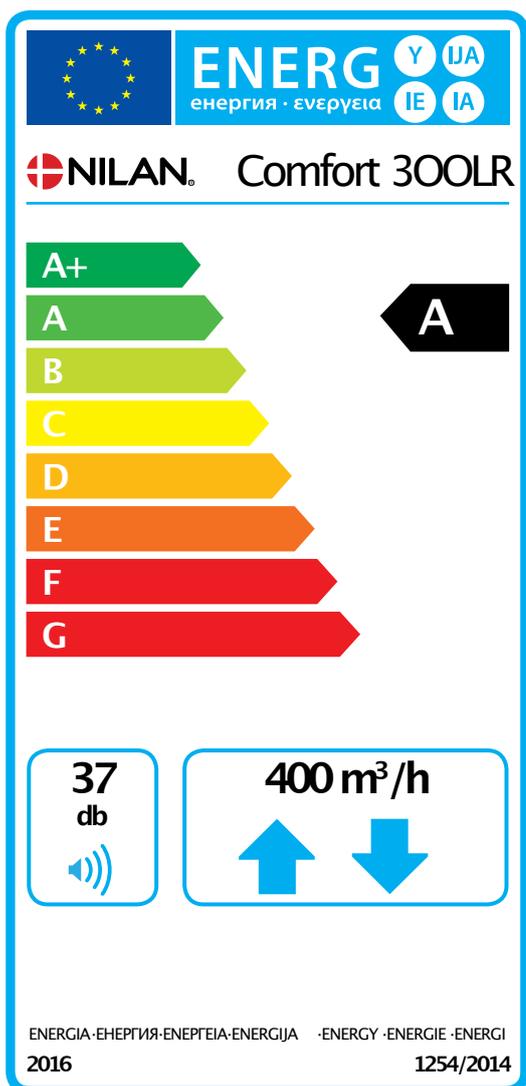

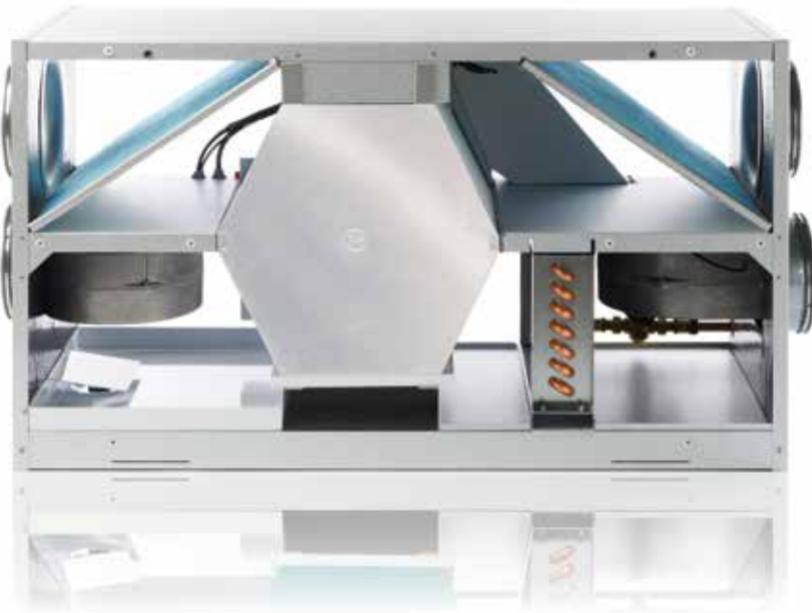

The two-sectioned door provides the user with an easy access for changing filters and also protects their fingers from getting caught in fans and heating elements.



Counterflow heat exchanger made of polystyrene, which has a higher temperature efficiency than aluminium exchangers.



Intelligent humidity sensors provide an option for controlling the ventilation as required, based on the average air humidity in the home. A CO<sub>2</sub> sensor can be purchased as an accessory.



The unit comes with a clear and user-friendly HMI touch panel. The modern CTS 602 control panel runs Modbus communication.



The powder-coated condensate drain prevents the formation of "acidwater" and allows the condensate to be drained away.



The efficient fans are powered by energy-saving EC motors.

They provide a constant air volume with a four-step adjustment.



Filter monitor with timer. ISO Coarse >90% (G4) filters are supplied as standard, but it is also possible to buy a ISO ePM1 50-65% (F7) pollen filter as an accessory.



Prepared for an integrated or external water heating element.



The automatic bypass damper makes the outdoor air bypass the heat exchanger when heat recovery is not required, thereby saving energy.

# TECHNICAL DATA

## Technical specifications

Dimensions (W x D x H)	1000 x 508 x 560 mm
Weight (1*)	45/33 kg
Plate type casing	Aluzinc steel plate
Heat exchanger type	Polyethyleneterephthalat counter flow heat exchanger with aluminium casing
Fan type	EC, constant volume
Filter class	ISO Coarse >90% (G4)
Duct connections	Ø 160 mm
Condensate drain	PVC, Ø 20x1,5 mm
Leakage classification (2*)	A1

Supply voltage	230 V (±10%), 50/60 HZ
Max. input/power	270 W/1,2 A
Tightness class	IP31
Standby power	3 W
Ambient temperature	-20/+40 °C
Heat loss (3*)	0,82 W/m²K
Heat loss classification	T2

\*1 33 kg is without side plates and exchanger

\*2 Testet according to EN13141-7

\*3 Testet according to EN1886

## Data ecodesign

SEC* average climate	-38.9 kWh/(m².a)
SEC* cold climate	-77.1 kWh/(m².a)
SEC* warm climate	-14.5 kWh/(m².a)
SEC-Class	A
Type	Two-way ventilation unit for residential
Type of drive	Variable speed drive
Type of heat recovery system	Recuperative (counterflow heat exchanger)
Thermal efficiency of heat recovery	87 %
Maximum flow rate	400 m³/h (100 Pa)
Electric power input of fan drive, including any motor control equipment, at maximum flow rate	108 W
Sound power level $L_{WA}$	37 dB(A)
Reference flow rate	0,078 m³/s (280 m³/h)
Reference pressure difference	50 Pa
SPI	0,27 W/(m³/h)
Central demand control	0.85
Maximum internal leakage	1.8 %
Maximum external leakage	1.12 %
Visual filter warning	An alarm on the user panel appears when filters need changing.  To maintain the performance and energy efficiency of the unit it is very important to change filters regularly.
Disassembly instructions	www.nilan.dk

AEC-annual electricity consumption	289 kWh/year (100 m²)
AHS** average climate	4548 kWh (100 m²)
AHS** cold climate	8898 kWh (100 m²)
AHS** warm climate	2057 kWh (100 m²)

\*\* Annual heating saved

The image shows an energy label for the NILAN Comfort 300LR. At the top, it features the European Union flag and the word 'ENERG' in large letters, with 'енергия · ενεργεια' and 'IE IA' below it. The brand name 'NILAN' and model 'Comfort 300LR' are prominently displayed. The energy efficiency class is shown as 'A' in a black arrow pointing to the right, with a scale from A+ (green) to G (red) on the left. Below this, the sound power level is indicated as '37 db' with a speaker icon. The maximum flow rate is shown as '400 m³/h' with two blue arrows pointing up and down. At the bottom, the text 'ENERGIA-ENERGIJA-ENERGIE' is repeated, along with the year '2016' and the number '1254/2014'.


\* Specific energy consumption

## Dimensional drawing

All dimensions are in mm.

Comfort 300LR shown with access to the primary side (heat exchanger) and connection to the right side.

Turned 180°, if the connection is desired to the left side.

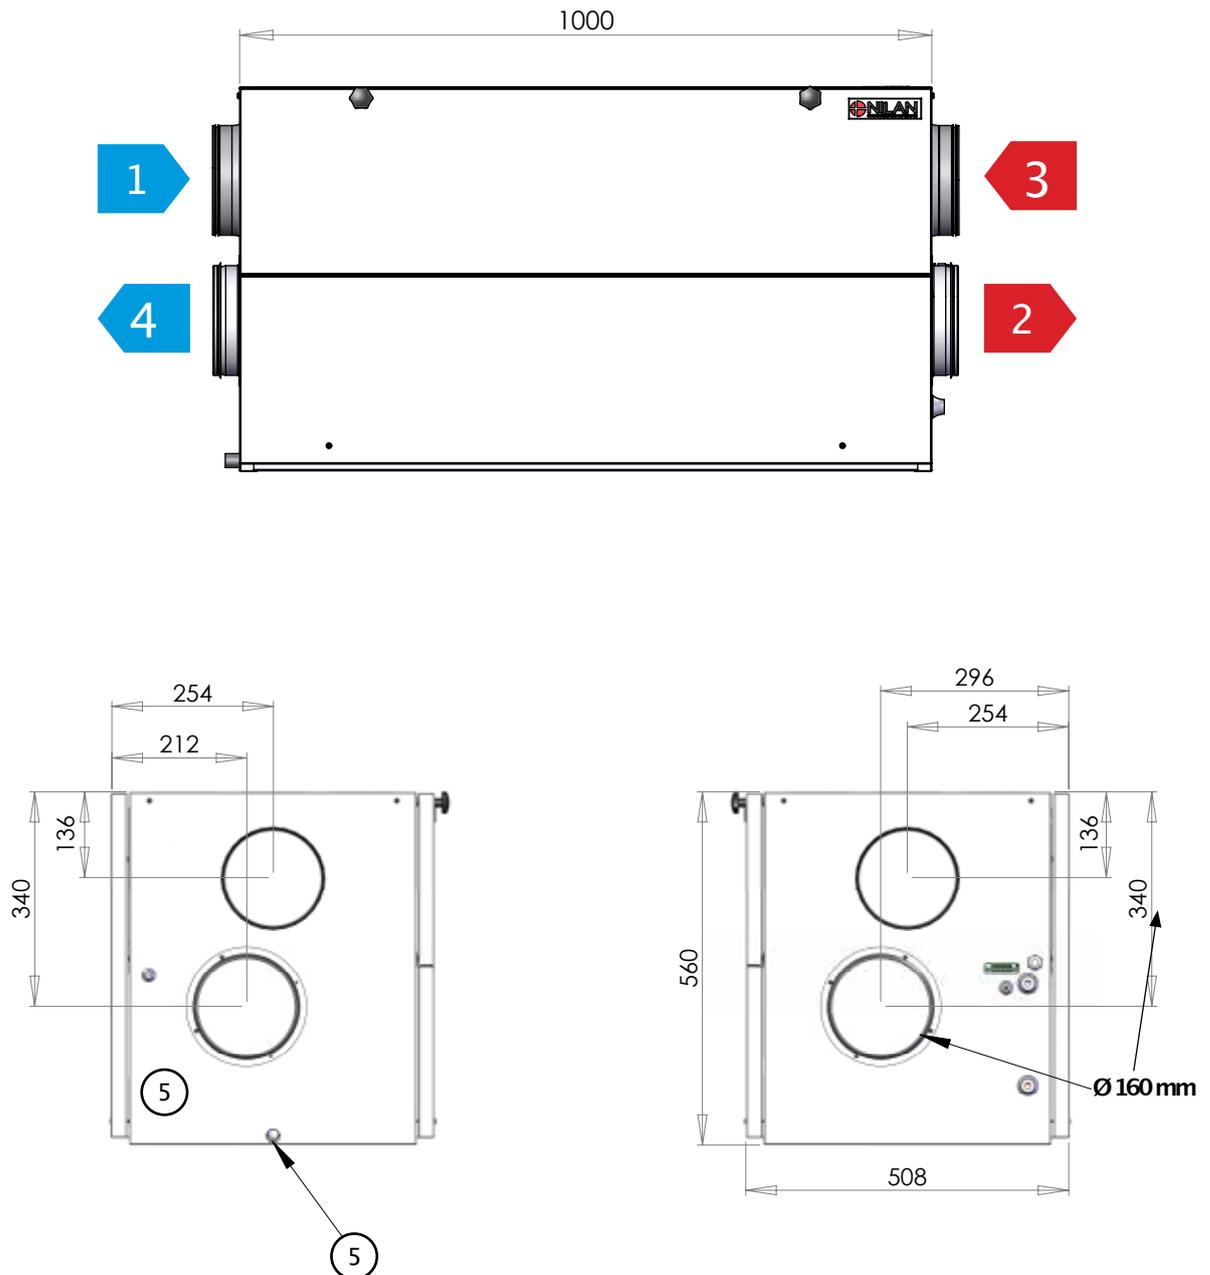

### Connections

- 1: Fresh air
- 2: Supply air
- 3: Extract air
- 4: Discharge air
- 5: Condensate drain
- 6: Electric and water heating

# PLANNING DATA

Nilan units are tested in accordance with the valid standards of accredited independent test institutes.

## Capacity

Capacity of standard unit as a function of  $q_v$  and  $P_{t,ext}$ .


SEL values according to EN 13141-7 are for standard units with ISO Coarse >90% (G4) filters and without heating element.

SEL values comprise the unit's total power consumption excl. control.

Conversion factor:


$$\frac{J/m^3}{3600} = W/m^3/h$$

**Attention! The SEL values are measured and stated as a total value for both fans.**

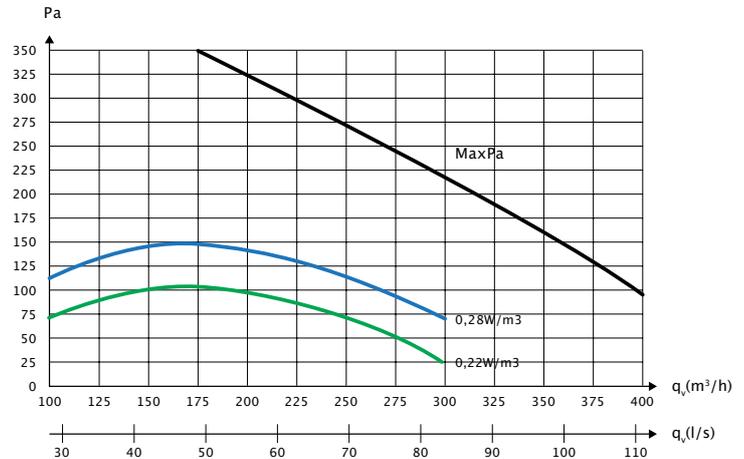

## Temperature efficiency

Temperature efficiency for units with counterflow heat exchanger according to EN 13141-7.

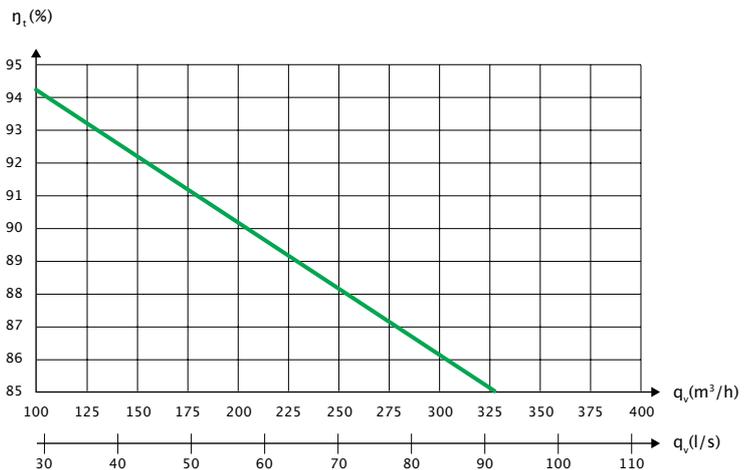

## Sound data

Sound data for  $q_v = 200 \text{ m}^3/h$  and  $P_{t,ext} = 100 \text{ Pa}$  according to EN 9614-2 for surfaces and EN 5136 for ducts.

Sound output level  $L_{WA}$  drops with falling air volume and falling back pressure.

Sound output level  $L_{pA}$  at a given distance will depend on acoustic conditions in the place of installation.

### Sound output level ( $L_{WA}$ )


Octave band Hz	Surface dB(A)	Supply air dB(A)	Extract air dB(A)
63	26	-	-
125	32	58	45
250	26	58	39
500	27	58	34
1000	17	61	30
2000	11	56	30
4000	10	50	23
8000	-	43	21
<b>Total ±2dB(A)</b>	<b>35</b>	<b>66</b>	<b>47</b>

## Capacity – Heating element (accessory)



### Electrical heating surface

The electrical heating surface is fitted in the air inlet duct at a distance of min. 2 x duct diameter from the system's fresh air inlet connection pipe (normally min 320 mm.) and connected to the CTS 602 control panel and 230 V supply. The electrical heating surface can supply up to 1,2 kW of heat.

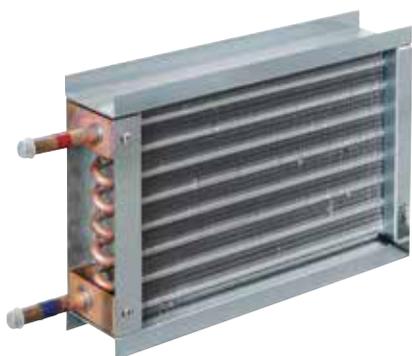

### Water heating element for internal fitting

The water heating element is designed to be built into the system and must be connected to the primary heating supply and the CTS 602 control. The water heating element includes copper pipes and aluminium fins.

Capacities can be seen in the table below.

### Capacity water heating element

Temperature input/output [°C]	Water side			Air side			
	Flow [m³/h]	Pressure drop [kPa]	Output [kW]	Flow [m³/h]	Temperature before WHE* [°C]	Temperature after WHE* [°C]	Pressure drop over WHE* [Pa]
40/30	0.05	0.8	0.53	100	16	32	2
	0.06	1.2	0.66	135	16	30	3
	0.08	2.1	0.89	210	16	29	5
	0.10	3.4	1.17	310	16	27	10
60/40	0.04	0.7	0.96	100	16	44	2
	0.05	1.0	1.19	135	16	42	3
	0.07	1.7	1.63	210	16	39	5
	0.09	2.7	2.10	310	16	36	10
70/40	0.03	0.4	1.09	100	16	48	2
	0.04	0.6	1.34	135	16	45	3
	0.05	1.0	1.82	210	16	41	5
	0.07	1.6	2.34	310	16	38	10

\* Water heating element.

# AUTOMATION

## CTS 602 Control




The Comfort 300LR is controlled using its CTS 602 HMI touch panel, featuring a wide range of functions, e.g., menu-controlled operation, weekly programme settings, filter monitor with timer, fan speed adjustment, summer bypass, supply-heating element control, error messages etc.

The CTS 602 comes with factory settings, including a default setting which can be customised to operational requirements to achieve optimum operation and utilisation of the system.

There is an option for selecting between 2 front page images for the main screen.

Operating instructions for the CTS 602 can be found in a separate user manual supplied with the unit.

## Functional diagram

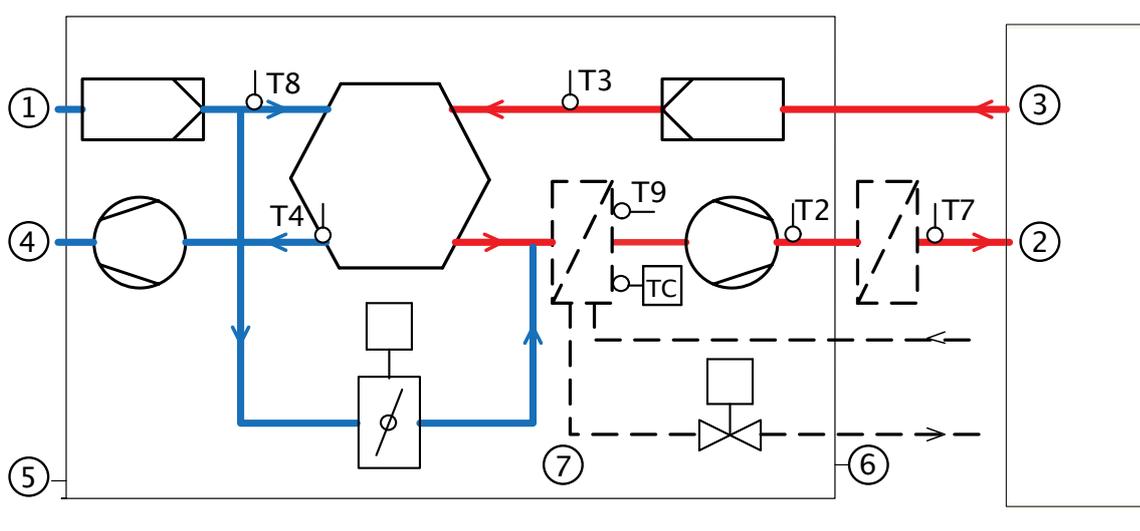

### Connections

- 1: Fresh air
- 2: Supply air
- 3: Extract air
- 4: Discharge air
- 5: Condensate drain
- 6: Electric and water heating

### Automation

- T2/T7: Supply air sensor
- T9/TC: Heating element frost protection
- T3: Extract air sensor
- T4: Discharge air and defrost sensor
- T8: Fresh air sensor

Functional overview		+Standard -Accessories
3 levels	The control function is divided into 3 levels:User/Service/Factory with various options at each level	+
Weekly plan	The unit has 3 weekly programmes (with a factory setting of "off") <ul style="list-style-type: none"> <li>•Programme 1: for working families</li> <li>•Programme 2: for stay-at-home families</li> <li>•Programme 3: for businesses</li> </ul> There is also an option for you to set your own weekly programme.	+
User option 1 & 2	This allows you to override the operating mode in the main menu via an external potential-free contact or PIR sensor.	+
Datalog	Possible to log data. Capacity 46.000 logs <ul style="list-style-type: none"> <li>•Adjustable between 1 and 120 minutes</li> <li>•If "OFF", only events and alarms are logged</li> </ul>	
Filter monitor	Filter monitor with timer (factory setting of 90 days).Adjustable to 30/90/180/360 days.	+
Bypass	Bypassing the outdoor air reduces heat recovery when heat recovery are not needed.	+
Air quality	Allows you to choose whether to switch humidity sensors and/or CO <sub>2</sub> sensors on and off.	+/-
Humidity control	Allows you to set a higher or lower ventilation step in the case of high/low air humidity.	+
CO <sub>2</sub> control	Allows you to set a higher or lower ventilation step in the case of a high CO <sub>2</sub> level.	-
Summer/Winter operation	Possible to set operation for summer and winter	
Winter low	Allows you to select a low ventilation step in the case of low outside temperatures	+
Defrost function	Temperature-based automatic function for defrosting the heat exchanger.	+
Frost protection	In case of failing heating system, the unit is turned off to avoid further cooling with a risk of the water heating coil frost bursting.	+
Room low	Stops the unit at a low room temperature. Hereby is cooling of the home avoided in case of a failing central heating system. Standard set to OFF. Can be set from 1 to 20 degrees and is controlled by: <ul style="list-style-type: none"> <li>•T3 EXHAUST(extract air)</li> </ul>	+
Air volume	Allows you to set four ventilation steps stepless. Supply air and extract air are set individually. Step 1 <25% - Step 2 <45% - Step 3 <70% - Step 4 <100%	+
External fire alarm	Possible to connect the unit to external fire alarm.	+
Joint alarm	Outlet for joint alarm	-
Intake air control	Allows you to set the regulator to control the intake air temperature/supply air (only available if the control unit has been configured for a supply-heating element).	+
External water heating element	<ul style="list-style-type: none"> <li>•Temperature sensor T7 is an supply air sensor</li> <li>•Integrated frost protection for external water heating element</li> <li>•Motorised valve and circulation pump control unit</li> </ul>	-
External electric heating element	<ul style="list-style-type: none"> <li>•Temperature sensor T7 is an supply air sensor</li> <li>•Overheating protection</li> </ul>	-
Delayed start-up	There is a possibility for a delayed start-up by the fans, when a closing damper is installed.	+
Reset	Allows you to restore the factory settings.	+
Manual test	Allows you to test the unit's functions manually.	+
Language	Option for setting the relevant language (Danish/Finnish/Norwegian/Swedish/German/English/French/Polish).	+

# COMMUNICATION


## External communication

The CTS 602 control unit communicates by default with Modbus RTU RS485 communication. A CTS system using this form of communication can easily be connected to the unit.

Nilan units have an open Modbus communication, i.e. not only can the unit be monitored, but its operation can also be set in the same way as it can via the operating panel.

The protocol is set up by default for a Modbus RTU 30 address, but can be set to a value between 1 and 247.

A Modbus converter allows you to connect one or more units to a computer to monitor and control the unit.

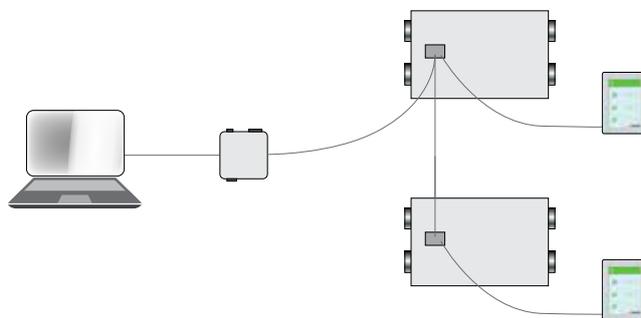

# OPERATION

## Intelligent humidity control


Nilan's humidity control feature automatically adapts to the needs of the family or the building.

The intelligent CTS 602 control unit does not need to have a set level input for air humidity (RH) to control the air exchange. By using the integrated humidity sensor, the control unit calculates the average level itself for the last 24 hours. The average level provides a basis for deciding whether to change the air exchange if the air humidity fluctuates.

This ensures that the unit always runs at its most efficient, based on the actual air humidity level and not on a theoretical one.

This helps save energy because it automatically adapts to the requirements in the home. Whether a large family or a single person is living in the building has a considerable influence on how much humidity is produced.

The unit also adjusts automatically to summer and winter level.

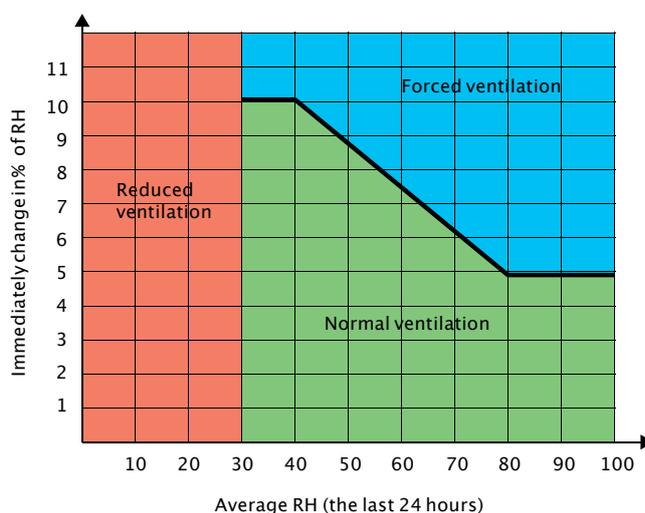

If the air humidity changes by more than 5–10% in relation to the average level, the unit responds with a higher rate of air exchange accordingly.

At an air humidity below 30% is reduced ventilation step activated (adjustable between 15 and 45%)


## Frost protection

All ventilation units with a counterflow heat exchanger will ice up if the outdoor temperature is below freezing for a prolonged period.

The extracted air condenses when it is cooled down during heat recovery. The high temperature efficiency will slowly turn the condensate to ice, which will block up the counterflow heat exchanger unless action is taken to remedy this.


Consideration must be given to whether the unit's operation can be protected during a lengthy period of frost or whether it is acceptable to decrease its operation.

In homes which are occupied at night, it would be advisable to protect the unit against frost when the outdoor temperature is coldest by using a pre-heating element. On the other hand, if the ventilation is for an office, it may be acceptable to decrease the operating level at night.

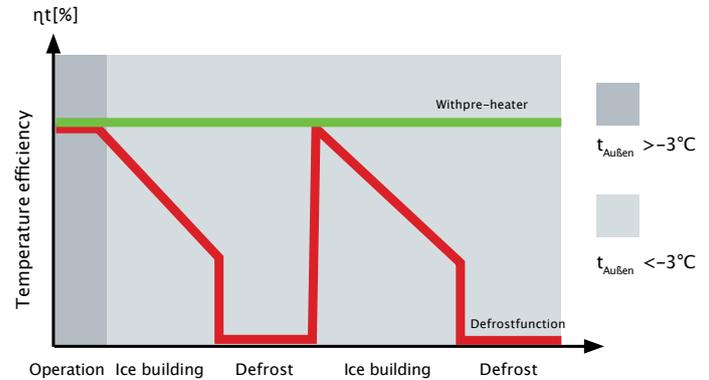

The energy used for the preheating is not wasted, as it ensures a constant high temperature efficiency

### Frost protection

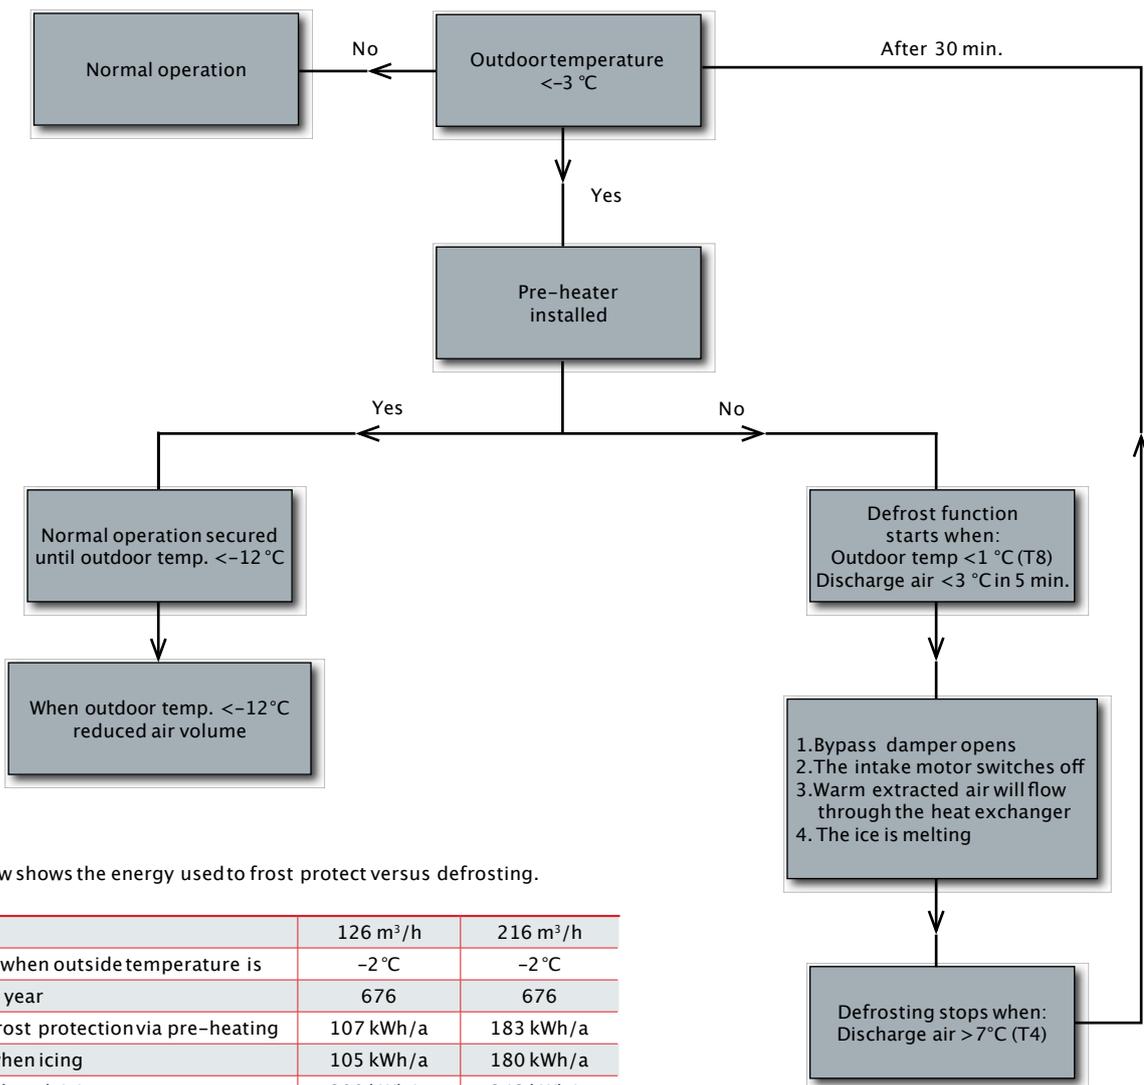

The example below shows the energy used to frost protect versus defrosting.

Air volume	126 m <sup>3</sup> /h	216 m <sup>3</sup> /h
Frost protection when outside temperature is	-2°C	-2°C
Hours during the year	676	676
Energy used to frost protection via pre-heating	107 kWh/a	183 kWh/a
Loss of energy when icing	105 kWh/a	180 kWh/a
Loss of energy when deicing	200 kWh/a	343 kWh/a
<b>Energy savings by using frost protection</b>	<b>198 kWh/a</b>	<b>340 kWh/a</b>


Average calculation by Danish dry weather data.

# ACCESSORIES



## CO<sub>2</sub>-sensor

With a CO<sub>2</sub>-sensor installed, the ventilation speed can be pre-programmed with CTS 602 to run at a higher ventilation steps when CO<sub>2</sub> reaches high level in the extract air. CO<sub>2</sub>-level is programmable (**expansion PCB required**).



## Water heating element incl. regulation

The supply temperature can always be raised to the required level using a water heating element. The water heating element is designed to be built into the unit and must be connected to the primary heating supply. Supplied with two-way adjustment valve, temperature sensor and frost thermostat (**expansion PCB included**).



## Electrical heating surface incl. regulation

When you fit an electrical heating surface, you can raise the fresh air temperature to the desired level at any time. The electrical heating surface is supplied ready to fit into the fresh air duct and, for easy fitting, the device is pre-fitted with all the required sensors (**expansion PCB included**).



## Electrical pre-heating element (Frost protection)

An electrical pre-heating element heats up the outdoor air before it enters the unit. This avoids having to defrost the unit, resulting in a loss of power. There are temperature sensors supplied to be fitted in the ducts.



## EM-box

An EM-box allows heat recovery from the air from the range hood and thereby helps to heat the supply air. The EM-box is equipped with a steel filter which efficiently cleans the range hood air of fat particles and thereby protects the system.



## Expansion PCB

The expansion PCB provides additional functions for the CTS 602 control unit.



## Pollen filter ISO ePM1 50-65% (F7)

A pollen filter class ISO ePM1 50-65% (F7) can be fitted in the unit. The pollen filter is fitted with the ISO Coarse >90% (G4) plate filter.



## Installation kit

The installation kit comprises of four vibration absorbers and a water trap for the condensation outlet. The water trap can be ordered separately.

## Heating cable

To protect the condensation outlet against frost, a 3 metre-long self-regulating heating cable can be ordered.

# DELIVERY AND HANDLING


## Transport and storage

Comfort 300LR comes in factory packaging that protects it during transport and storage. Comfort 300LR must be stored in a dry place in its original packaging until installation. The packaging should only be removed immediately prior to installation.

## Installation conditions

During installation, future service and maintenance should be taken into account. We recommend a minimum space in front of the unit of 60 cm.



The unit must be installed level for the sake of the condensate drain. The condensate drain requires clearance of min. 12,5 cm under the drain nozzle.

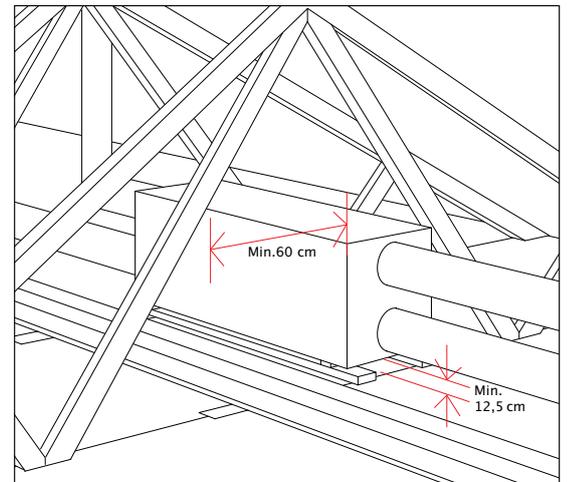

## Installation of electric heating element

Electric heating elements (accessories) are fitted in the duct. The heating element must be insulated using fire-resistant insulation material.

The electric heating element must be connected by an authorized electrician.

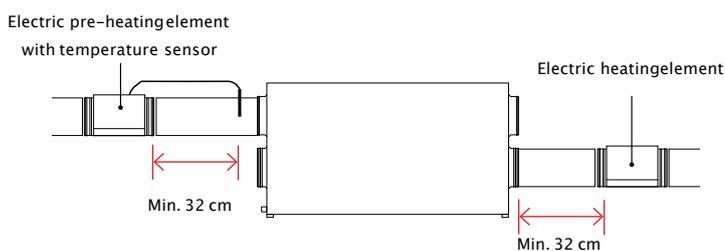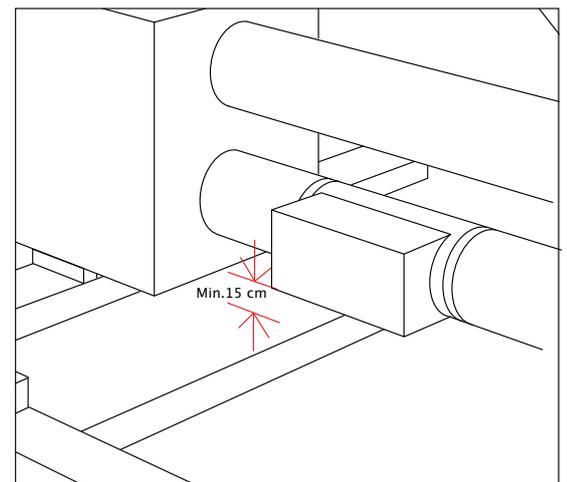

# NILAIR

NilAIR is installed together with a ventilation unit, which in simple terms consists of distribution boxes from which tubes are led out to air extraction and air supply boxes in the individual rooms.

NilAIR can be installed in ceilings, walls or floors. The lightweight tubes can be used for even the most complicated tube alignments, where e.g. traditional spiral ducts cannot be used.

## Advantages

- Flexible and space-saving solution
- Rapid and simple installation with a click system
- Dimensionally stable and corrosion-resistant quality material
- Simple regulation of the air supply volume
- Low weight
- Airtight
- Easy to clean
- Easy to handle and transport
- Prevents sound travelling from room to room

NilAIR is already installed in thousands of European homes and since its introduction more than ten years ago its use has steadily increased, due to the rapid and easy installation without any special tools being required.

## Enabling the impossible

Traditional air distribution systems take up a lot of space and often make special building structures impossible. NilAIR virtually eliminates this problem, due to the tubes' size and flexibility.


## Installation examples



# NILAIR PRINCIPLE

## Air extraction

(mounted in wall or ceiling)

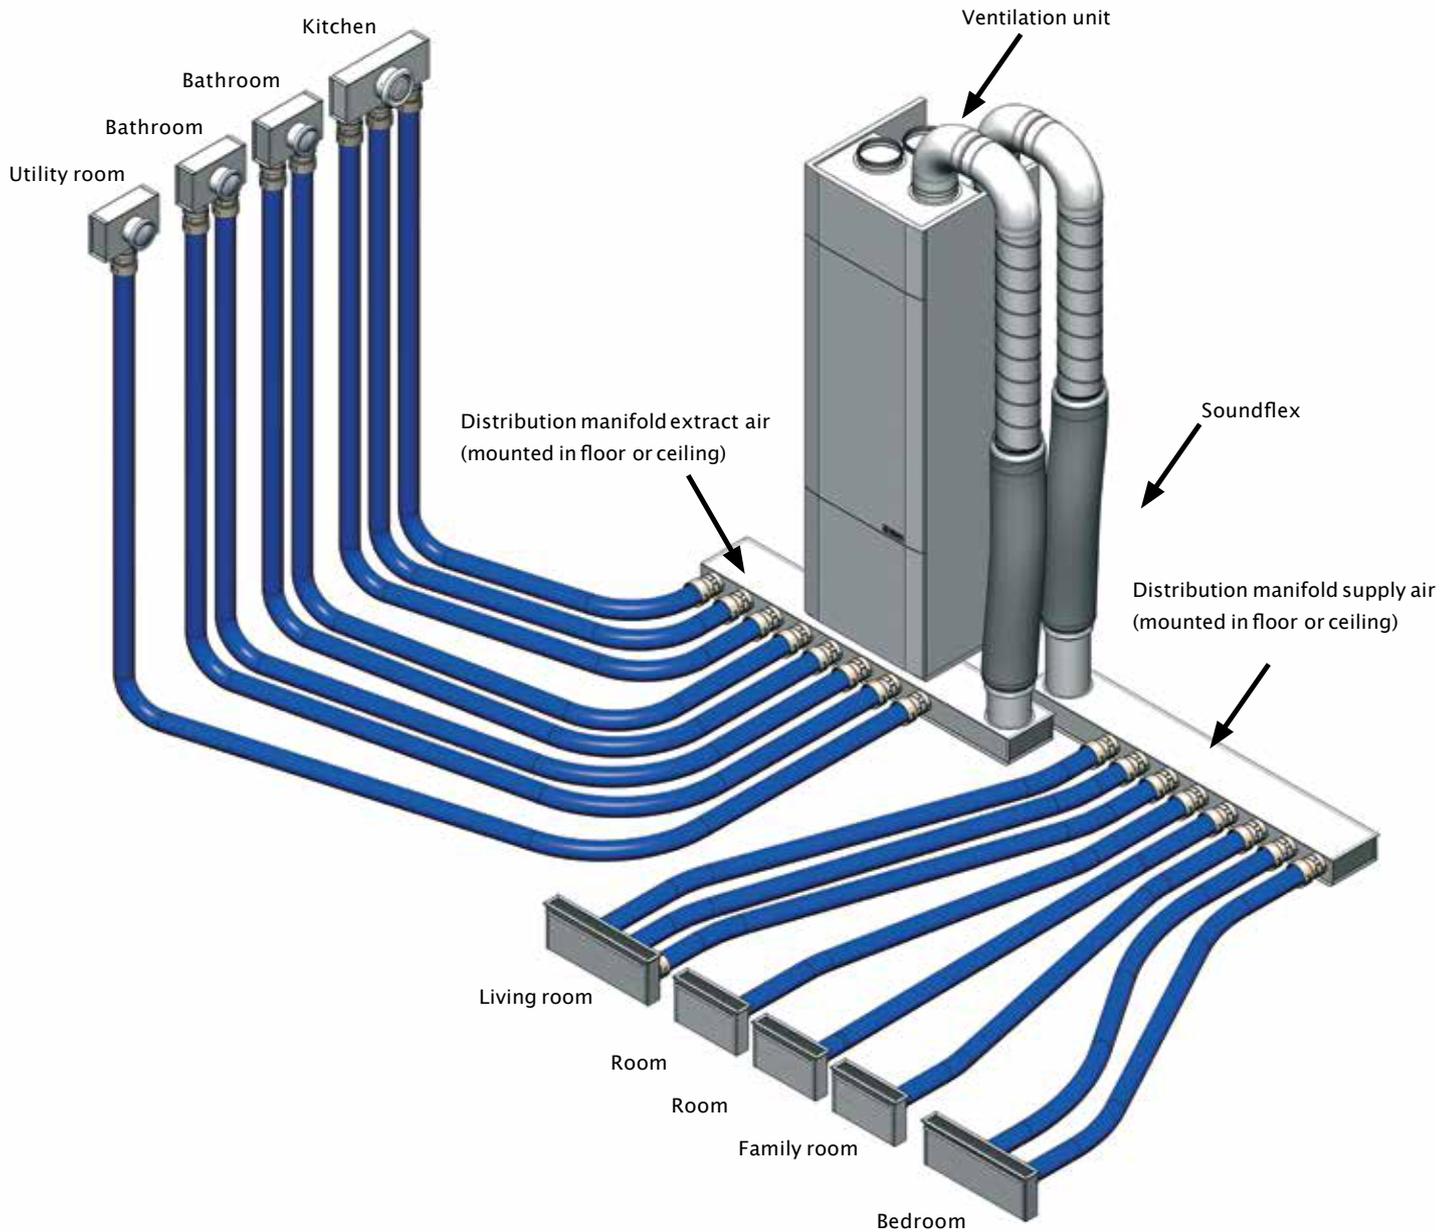

## Air supply

(mounted in floor, wall or ceiling)

# INFORMATION FROM A TO Z

Nilan develops and manufactures premium-quality, energy-saving ventilation and heat pump solutions that provide a healthy indoor climate and low-level energy consumption with the greatest consideration for the environment. In order to facilitate each step in the construction process - from choosing the solution through to planning, installation and maintenance - we have created a series of information material which is available for download at [www.nilan.dk](http://www.nilan.dk).



## Brochure

General information about the solution and its benefits.



## Product data

Technical information to ensure correct choice of solution.




## Installation instructions

Detailed guide for installation and initial adjustment of the solution.



## User manual

Detailed guide for regulation of the solution to ensure optimum day-to-day operation.



## Drawings

Tender documents and 3D drawings are available to download for planning purposes.



Horsham, West Sussex  
01403 563045

[www.slservicesgroup.com](http://www.slservicesgroup.com)